


AEC TYPICAL CAMPER SERVICE POLE USING SERVICE ENTRANCE (S.E.) CABLE

#4 BARE COPPER WIRE STAPPLED
ENTIRE LENGTH OF POLE AND
CONNECTED TO GND ROD. LEAVE
18 INCHES AT TOP OF POLE

MINIMUM OF 16FT ROUND - PRESSURE TREATED POLE.
6 INCHES IN DIAMETER. THE LOCATION OF THE POLE SHALL
BE DETERMINED BY A.E.C. A TALLER POLE MAY BE REQUIRED
IN SOME CASES FOR CLEARANCE PURPOSES.

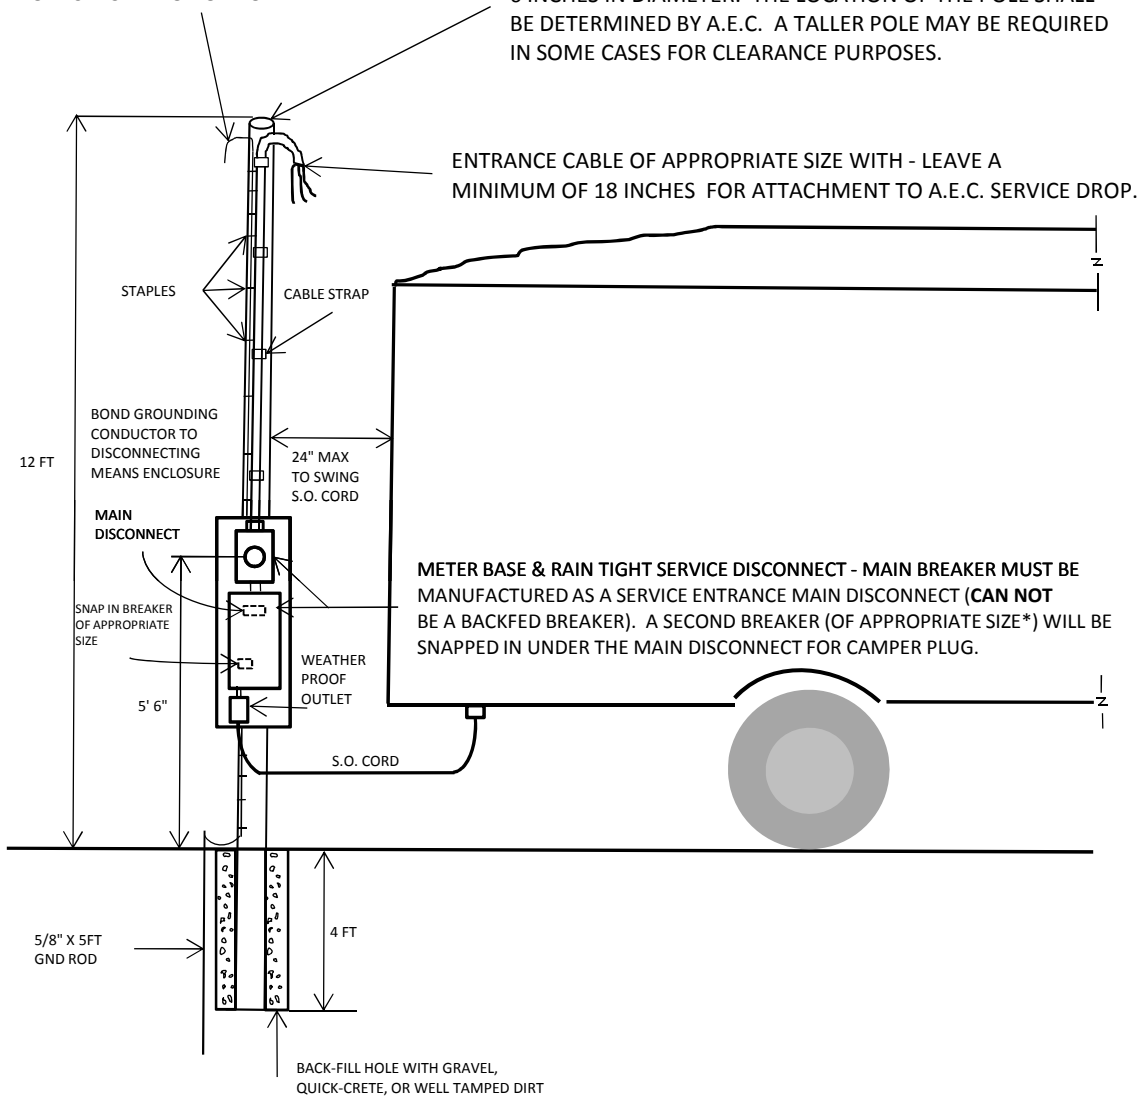

***NOTE:** CAMPER S.O. CORD, WEATHER PROOF OUTLET, BREAKER, AND WIRE BETWEEN
BREAKER AND OUTLET SHOULD ALL BE OF THE APPROPRIATE SIZE. FOR EXAMPLE:
30A CAMPER WILL REQUIRE → 30A BREAKER, 10-3 WIRE, & 30A WEATHER PROOF OUTLET