




ARAB ELECTRIC CO-OP

TYPICAL UNDER GROUND SERVICE TO A RESIDENCE FROM A PAD-MOUNT TRANSFORMER. LOCATION OF METER BASE WILL BE DETERMINED BY A.E.C. - NO BACK FILLING SHALL BE DONE PRIOR TO INSPECTION AND APPROVAL OF A.E.C.

 = RIGID GALV. CONDUIT OF APPROPRIATE SIZE
 = " GREY" SCH. 40 ELECTRICAL CONDUIT OF APPROPRIATE SIZE.

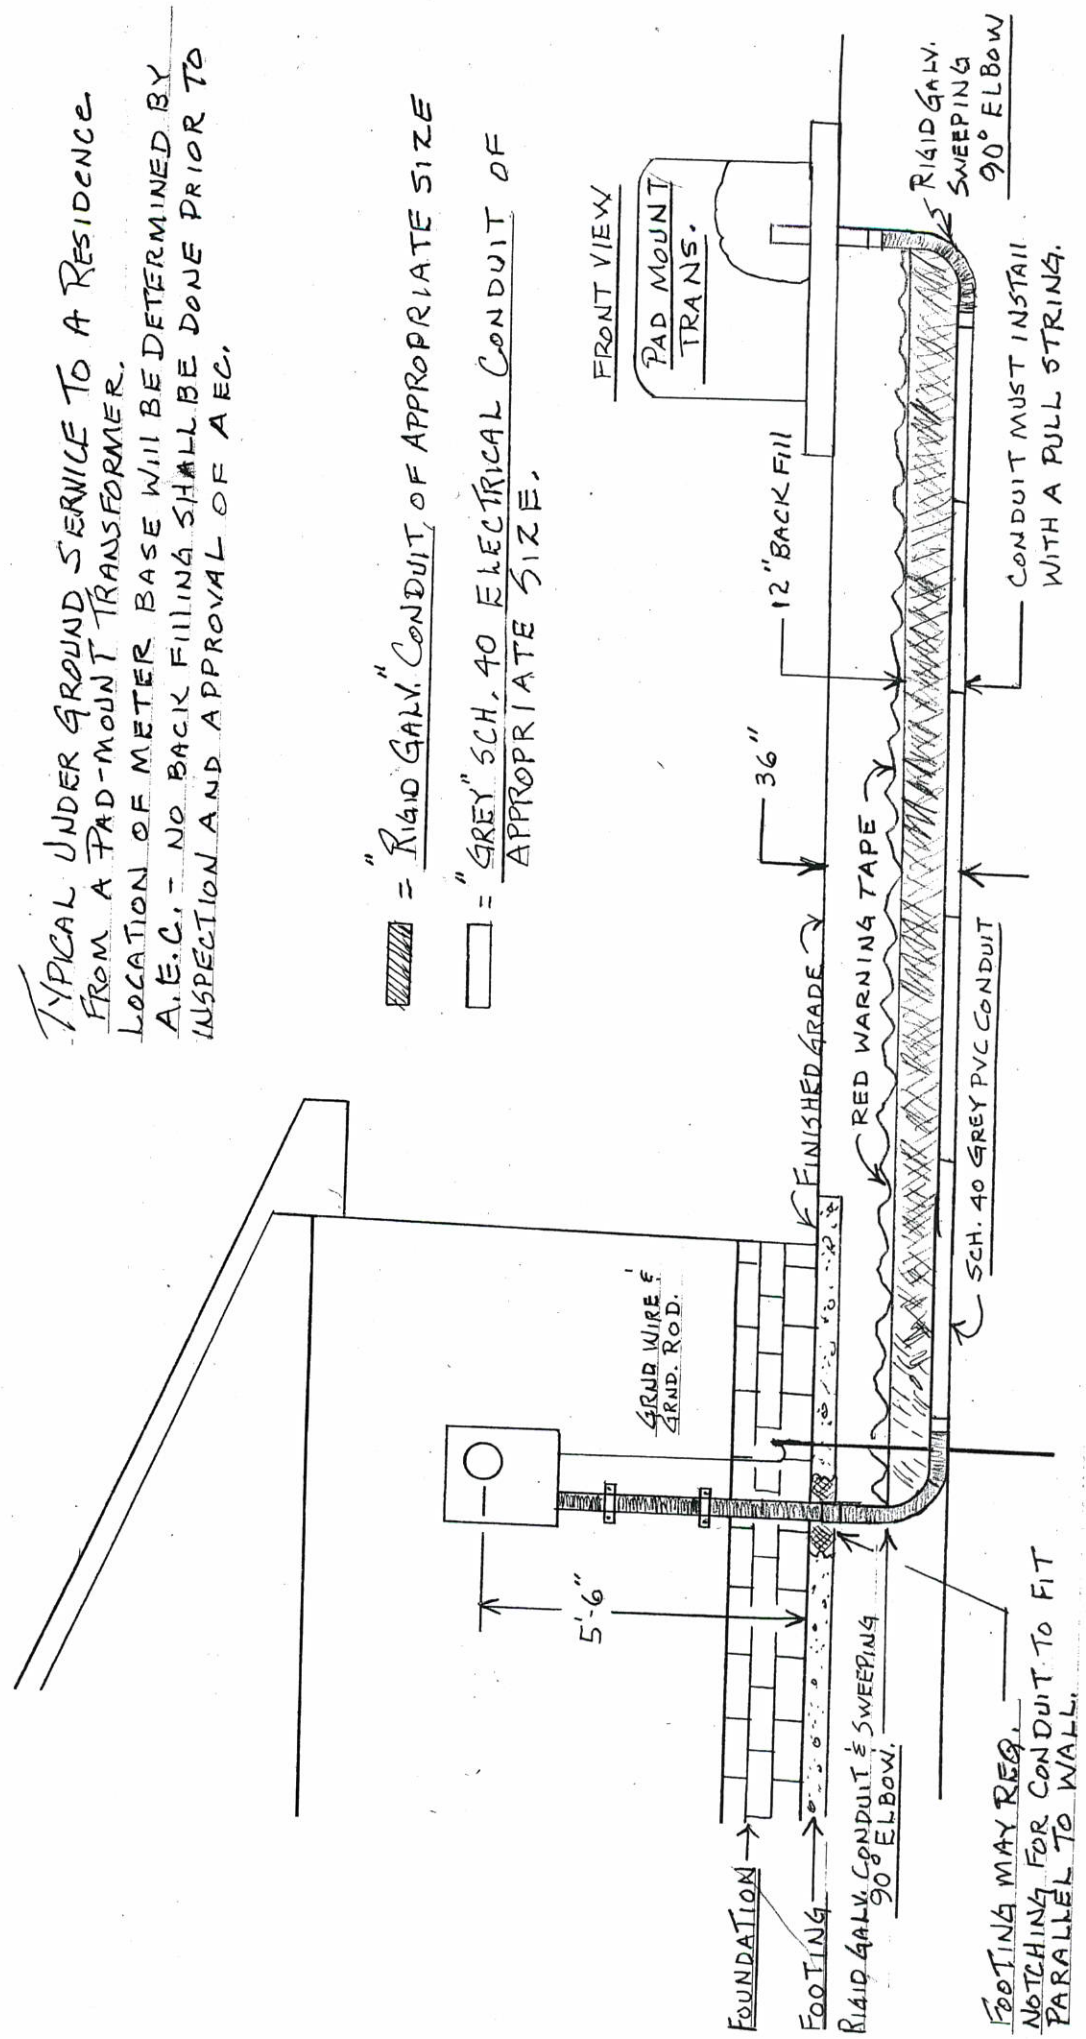

CONDUIT MUST INSTALL WITH A PULL STRING.

FOOTING MAY REQ. NOTCHING FOR CONDUIT TO FIT PARALLEL TO WALL.